


GENERAL NOTES


1. STRIP AND REMOVE ALL VEGETATION, LOOSE TOPSOIL, TREES AND ROOTS WITHIN THE CONSTRUCTION AREA.
2. ONCE FINAL SUBGRADE ELEVATION HAS BEEN ACHIEVED, THE EXPOSED SUBGRADE SHALL BE PROOF-ROLLED WITH A PIECE OF EARTHWORK EQUIPMENT (MOTORIZED SCRAPER OR DUMP TRUCK WEIGHING AT LEAST 20 TONS) TO DETECT SOFT OR LOOSE ZONES OF MATERIAL. REMOVE ANY OBJECTIONABLE MATERIAL DETECTED BY THE PROOF ROLLING & REPLACE WITH COMPACTED FILL AS DESCRIBED ABOVE.
3. CONCRETE SHALL MEET THE REQUIREMENTS OF TXDOT (2014) ITEM 421 – HYDRAULIC CEMENT CONCRETE, CLASS A, WITH THE FOLLOWING MODIFICATIONS: MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3,500 PSI; SLUMP SHALL RANGE FROM 4 INCHES TO 6-1/2 INCHES AT THE POINT OF PLACEMENT.

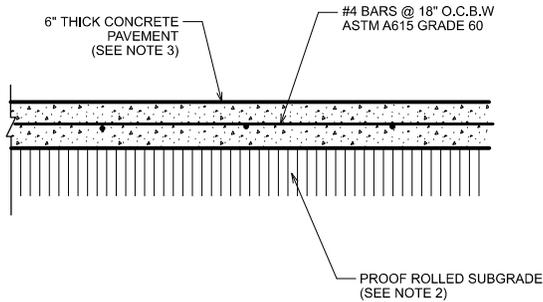

5 CONCRETE PAVEMENT

GENERAL NOTES

1. EXPANSION JOINTS SHALL BE LOCATED AT 40' INTERVALS. EXPANSION MATERIAL SHALL BE 3/4" BITUMINOUS FELT. USE (3) 5/8" DOWELS WITH SLEEVES.
2. CONTRACTION JOINTS SHALL BE SCORED AT 10' INTERVALS.
3. TRANSVERSE BARS MAY BE OMITTED IF CURB & GUTTER IS MACHINE LAID.
4. CONCRETE SHALL MEET THE REQUIREMENTS OF TXDOT (2014) ITEM 421 –HYDRAULIC CEMENT CONCRETE, CLASS A, WITH THE FOLLOWING MODIFICATIONS: MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3,500 PSI; SLUMP SHALL RANGE FROM 4 TO 6-1/2 INCHES AT THE POINT OF PLACEMENT.

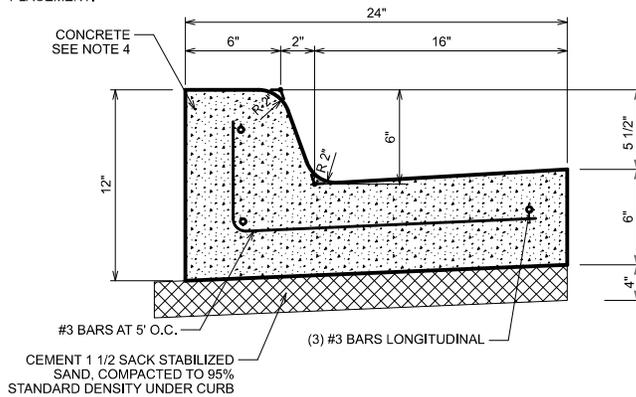

6 CONCRETE CURB & GUTTER



Matt A. Glaze
2/5/20

**ADDENDUM NO. 1
DETAILS**

DOWNTOWN WATERFRONT ACCESS IMPROVEMENTS
CITY OF PORT LAVACA



2004 N. Commerce, Victoria, Texas 77901 · 361.578.9836
urbanvictoria.com · TREF# F-160